


PLAN

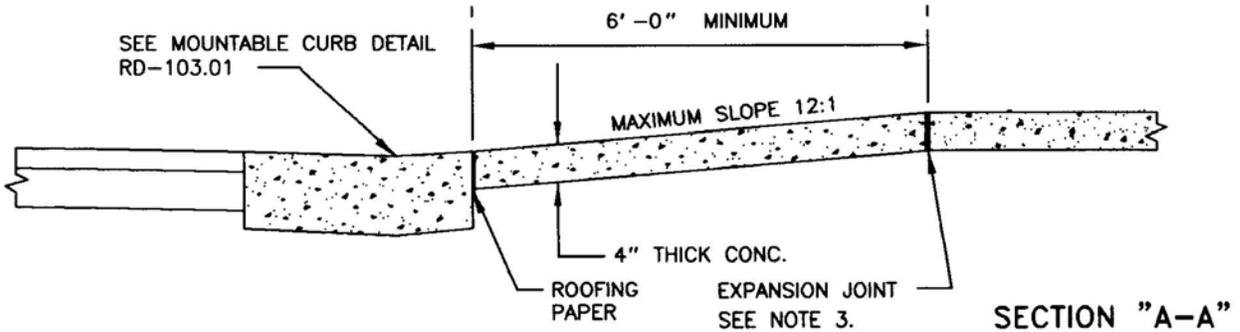

SECTION "A-A"

NOTES:

1. ALL METHODS OF CONSTRUCTION SHALL BE IN COMPLIANCE WITH QUEEN ANNE'S COUNTY STANDARDS. ALL MATERIAL SPECIFICATIONS SHALL COMPLY WITH THE 2001 EDITION OF THE MARYLAND STATE HIGHWAY ADMINISTRATION'S "STANDARD SPECIFICATIONS FOR CONSTRUCTION AND MATERIALS" MANUAL AND ANY ADDENDUM THERETO.
2. CONCRETE SHALL BE SHA MIX NO. 2, 3,000 PSI - 28 COMPRESSIVE STRENGTH.
3. SIDEWALK RAMPS SHOULD BE LOCATED AS INDICATED. HOWEVER, EXISTING SURFACE UTILITIES AND EXISTING OR PROPOSED GEOMETRICS MAY AFFECT PLACEMENT.
4. EXPANSION JOINT MATERIAL SHALL BE 1/2 INCH PREFORMED CORK, TRIMMED AND SEALED WITH NON-STAINING, TWO COMPONENT POLYSULFIDE OR POLYURETHANE ELASTOMERIC TYPE SEALANT.

\\VOLI\CAD\ROAD STANDARDS\FINAL\SIDEWALK_RAMP_104.03.DWG

APPROVED _____

[Signature]
 DATE _____
 ACTING DIRECTOR, DEPT. OF PUBLIC WORKS

 CHIEF ROADS ENGINEER

SCALE: NO SCALE
REVISIONS:

QUEEN ANNE'S COUNTY
 DEPARTMENT OF PUBLIC WORKS

SIDEWALK RAMP

STANDARD NO. RD-104.03